



FRONT VIEW

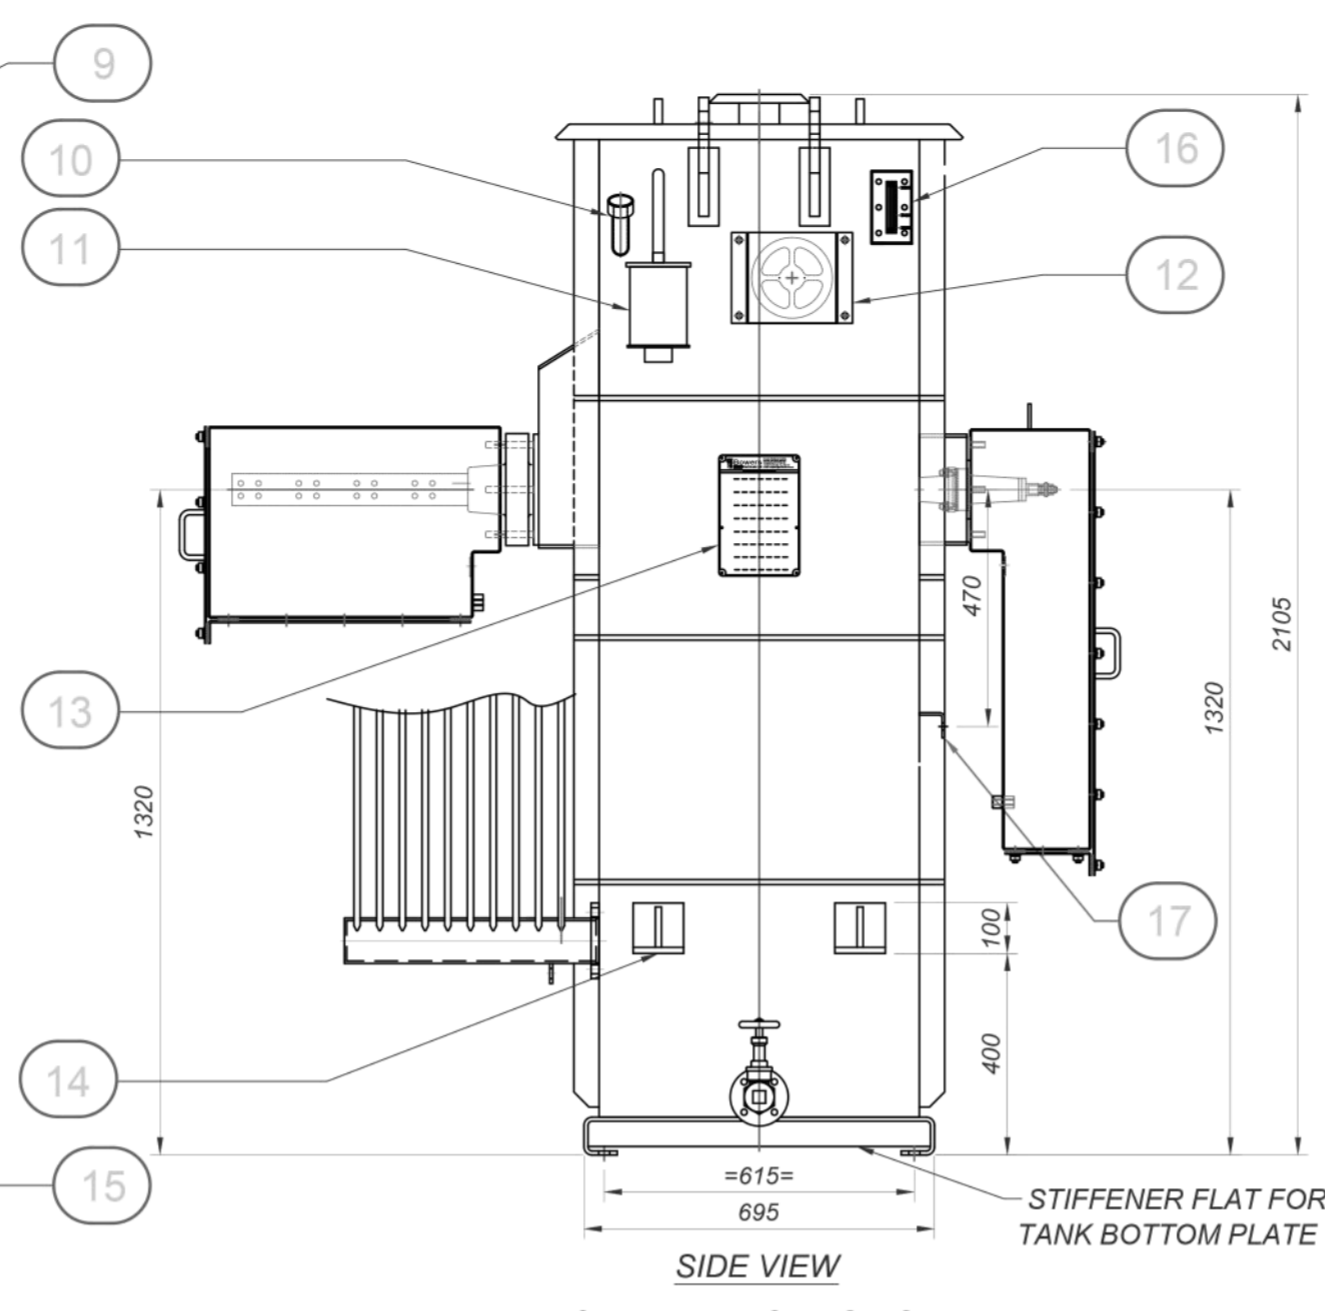


SIDE VIEW

WITHOUT RADIATOR FOR CLARITY

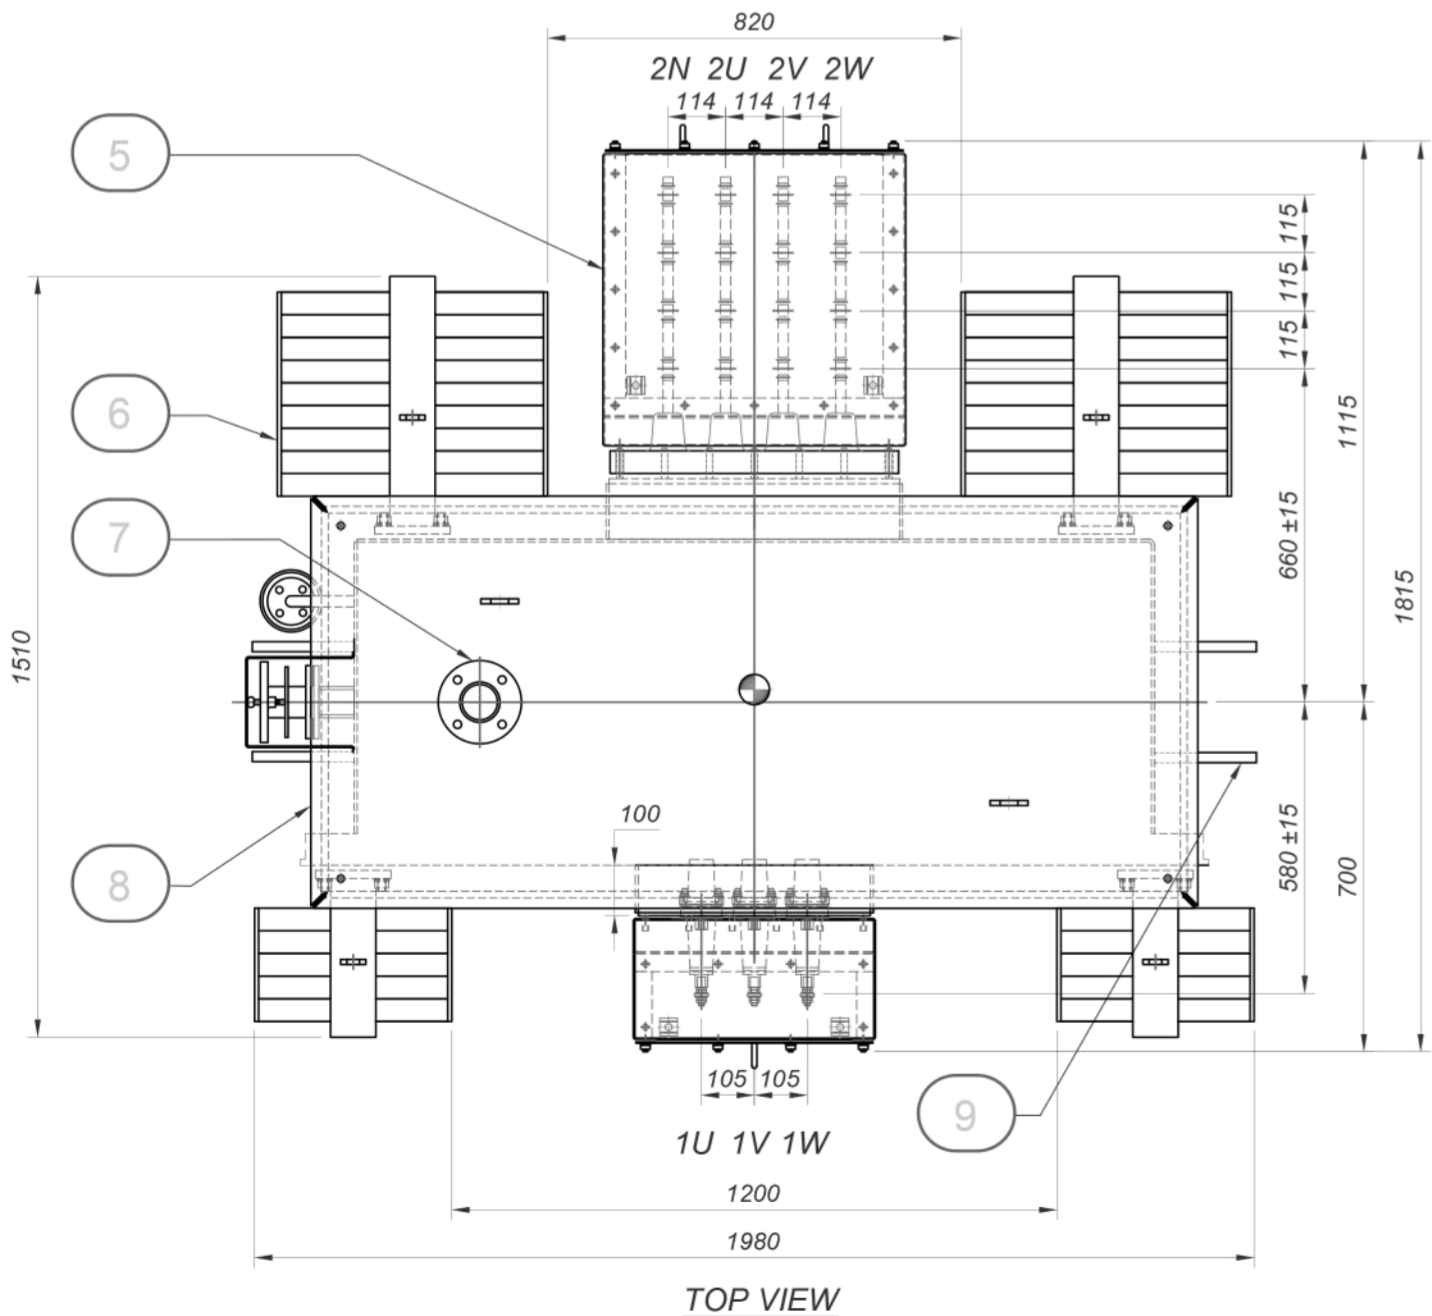

TOP VIEW

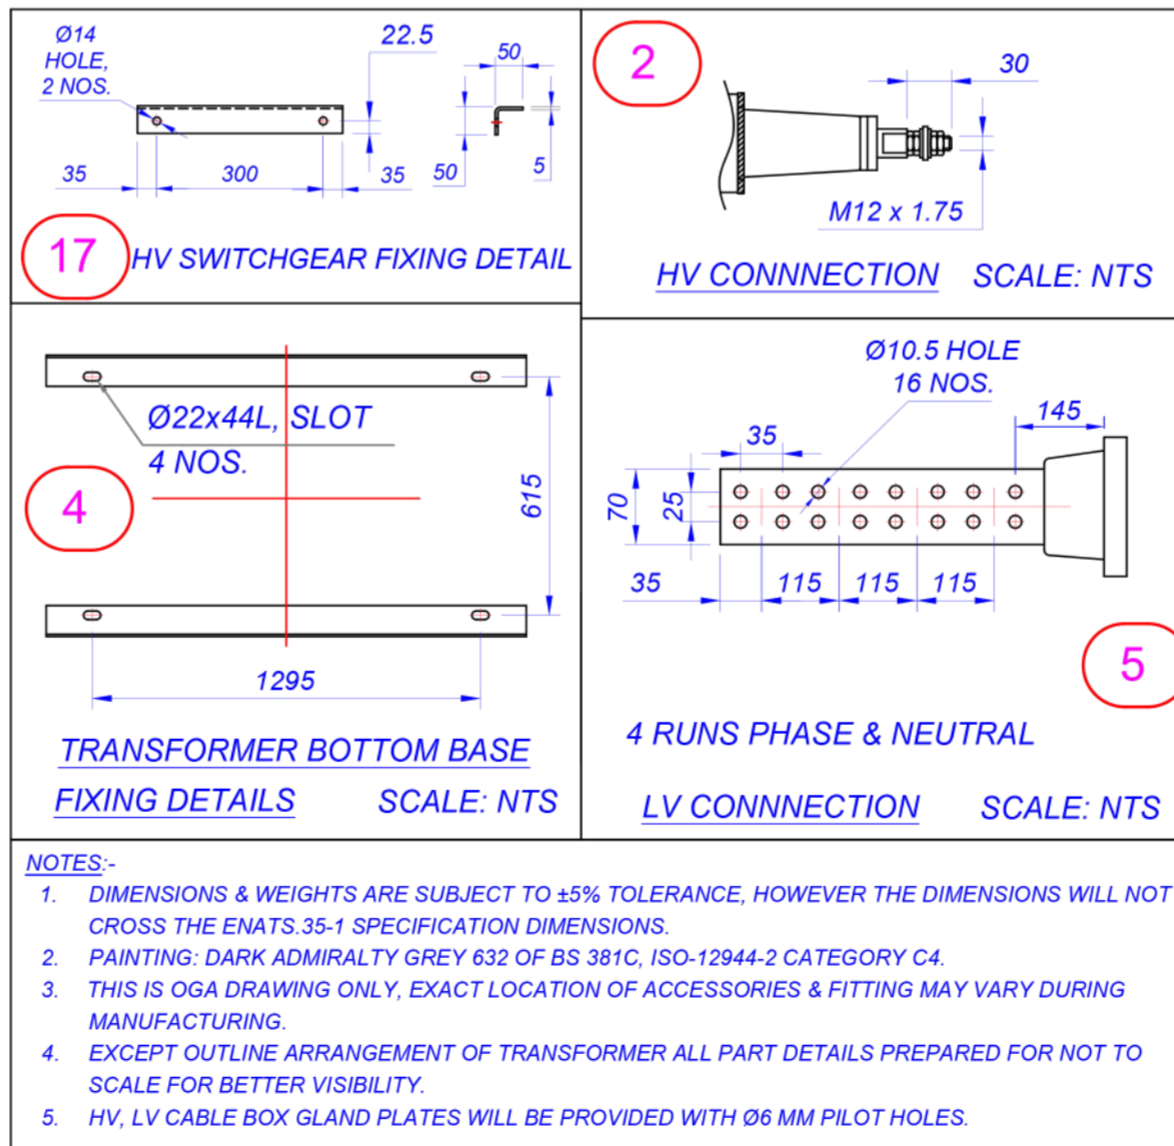

NOTES:-

- DIMENSIONS & WEIGHTS ARE SUBJECT TO ±5% TOLERANCE, HOWEVER THE DIMENSIONS WILL NOT CROSS THE ENATS.35-1 SPECIFICATION DIMENSIONS.
- PAINTING: DARK ADMIRALTY GREY 632 OF BS 381C, ISO-12944-2 CATEGORY C4.
- THIS IS OGA DRAWING ONLY, EXACT LOCATION OF ACCESSORIES & FITTING MAY VARY DURING MANUFACTURING.
- EXCEPT OUTLINE ARRANGEMENT OF TRANSFORMER ALL PART DETAILS PREPARED FOR NOT TO SCALE FOR BETTER VISIBILITY.
- HV, LV CABLE BOX GLAND PLATES WILL BE PROVIDED WITH Ø6 MM PILOT HOLES.

17	HV SWITCHGEAR FIXING DETAIL (50x50x5 THK. MS.ANGLE)
16	PRISMATIC OIL LEVEL INDICATOR
15	EARTHING TERMINAL SUITABLE FOR M12 BOLT (ONE ON EACH SIDE) (SS-316)
14	JACKING PADS
13	RATING AND TERMINAL MARKING PLATE
12	OFF-CIRCUIT TAP SWITCH (MODEL: 12kV 100A, 6 POSITION) WITH ENCLOSED COVER
11	BREATHER FIXING PIPE WITH 3/4" BSP MALE CONNECTION (BREATHER WILL BE SUPPLY LOOSE)
10	THERMOMETER POCKET SUITABLE FOR 3/4" BSP MALE CONNECTION
9	LIFTING LUGS FOR COMPLETE TRANSFORMER
8	BOLTED TYPE TOP COVER
7	LIQUID FILLING PIPE WITH COVER
6	PSR RADIATOR BOLTED TYPE (1200X375X 6FINS) & (1200X520X 10FINS)
5	LV CABLE BOX 4 POLE, 4 CONNECTION/PHASE WITH 1.1KV EPOXY MONOBLOCK BUSHING AS PER BS2562
4	SKID TYPE UNDER BASE ARRANGEMENT (Ø35)
3	DRAIN VALVE WITH PLUG & SAMPLER (MODEL : 25 mm, PN16)
2	HV CABLE BOX ASSEMBLY (3 POLE) WITH BS 2562 12kV, 250A PORCELAIN BUSHINGS (TERMINATION KIT REQUIRED)
1	LIFTING LUGS (ONLY FOR TOP COVER)
SL.No.	DESCRIPTION

BOWERS JOB No.	-
OUTPUT	2000 kVA
VOLTAGE RATIO	11000 / 415
AMPERES	104.97 / 2782.41
PHASES	3
FREQUENCY	50Hz
VECTOR SYMBOL	Dyn11

ESTIMATED WEIGHTS	KG
CORE AND WINDINGS	3150
COOLING LIQUID	1115 LTRS
TOTAL WEIGHT	5450



This drawing is COPYRIGHT and the property of Bowers Electricals Ltd. It must not be copied (in whole or in part) without prior written consent of the company. ©

TOLERANCE UNLESS OTHERWISE STATED
 ± 0.5mm FOR DIMENSIONS UP TO 250mm:
 ± 1mm FOR DIMENSIONS UP TO 1000mm:
 ± 2mm FOR DIMENSIONS OVER 1000mm.

RevNo	Revision Note	Date	Signed	Checked

Bowers
 Electricals Ltd
 Heanor Gate Road, Heanor,
 Derbyshire, DE75 7GX
 Tel: 01773 531531 Fax: 01773 716 171
 Email: enquiries@bowerselec.co.uk

Drawn by SAMPLE	Checked by SAMPLE	Approved by SAMPLE	Job No. STOCK	Date 16/04/21	Size A2
GENERAL ARRANGEMENT OF 2000KVA 11000/415V TIER 2 TRANSFORMER		DRG No. FOR INFO ONLY		FIRST ANGLE	Scale 1:15
				Revision 1/1	Sheet 1/4